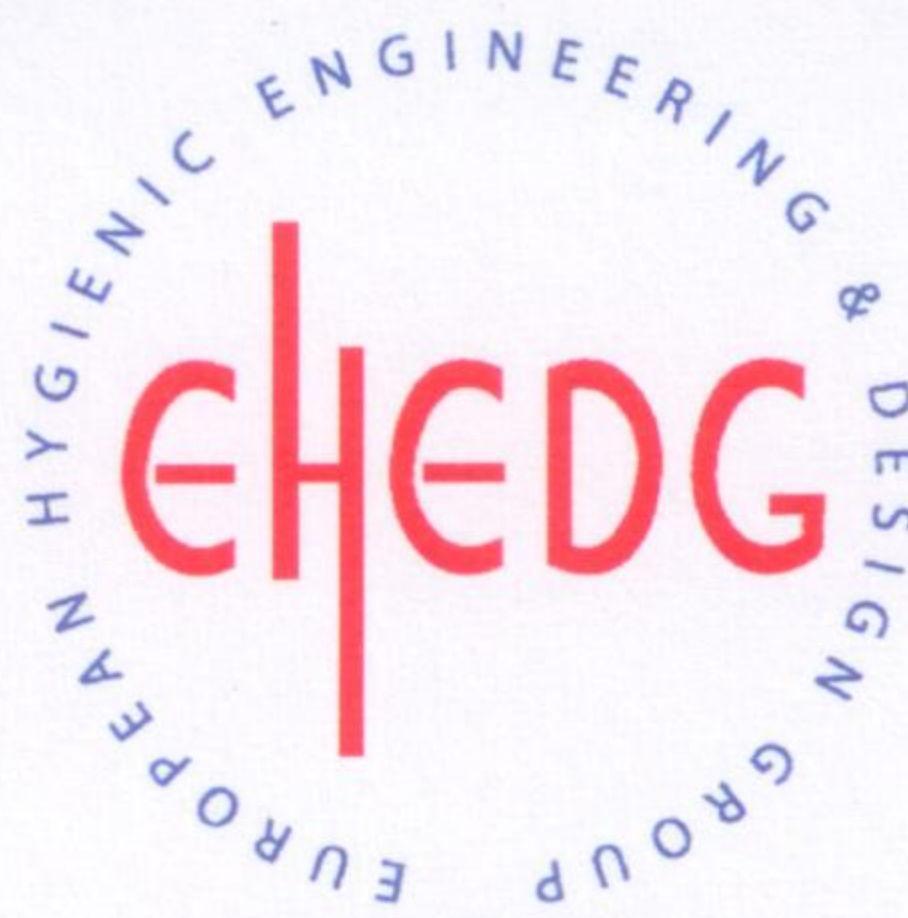


CERTIFICATE OF COMPLIANCE

Valid until end: December 2019



**TYPE EL
ASEPTIC CLASS I**

*TUM Certification
hereby declares that the product*

retractable assembly Cleanfit type CPA875 with EPDM gaskets

from

Endress+Hauser Conducta GmbH + Co. KG, 70839 Gerlingen, Germany

*has been evaluated for compliance with the
Hygienic Equipment Design Criteria of the EHEDG, by:*

TUM (Forschungszentrum für Brau- u. Lebensmittelqualität) at Weihenstephan, Germany

and meets the criteria as demonstrated by:

Evaluation Report No. 494TUM2016

Signed

Jürgen Hofmann

Dr. Jürgen Hofmann

Evaluation Officer

Signed

Fritz Jacob

Prof. Dr. Fritz Jacob

Head of Department

Date of issue: 09 August 2016

Certificate No. 25/2016



TECHNISCHE
UNIVERSITÄT
MÜNCHEN

FORSCHUNGSZENTRUM
WEIHENSTEPHAN

für Brau- und
Lebensmittelqualität

85354 Freising-Weihenstephan, Germany

©EHEDG

Appendix 3

EHEDG CERTIFICATION - EQUIPMENT EVALUATION FORM
 OFFICIAL ENGLISH VERSION
IN-PLACE CLEANABLE EQUIPMENT INTENDED FOR ASEPTIC APPLICATIONS
 (PROVEN STEAM STERILISABLE AND BACTERIA TIGHT), TYPE EL ASEPTIC CLASS I

Equipment:

Name: Endress+Hauser GmbH + Co. KG
 Type no.: retractable assembly Cleanfit type CPA875 with EPDM gaskets
 Other essential identification:

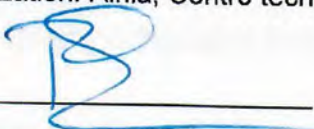
Date: 09.08.2016
 Number: 25/2016

Evaluated by:


Name: Dr. Jürgen Hofmann
 EHEDG or EHEDG Authorized Organization: TUM, BLQ, Germany

Approved by:

Name: Rafa Soro
 EHEDG or EHEDG Authorized Organization: Ainia, Centro tecnológico, Valencia, ES

Date, Signature: 23/08/16 

1. Results of inspection for compliance with the EHEDG Hygienic Design Criteria. Conclusion: The equipment complies with the criteria.	YES <input type="checkbox"/>
	MAYBE <input checked="" type="checkbox"/>
	NO <input type="checkbox"/>
2. Only unavoidable reasons for non-compliance present. Evidence for compensation provided and convincing for Certification. Conclusion: The equipment complies with the criteria where possible.	YES <input checked="" type="checkbox"/>
	NO <input type="checkbox"/>
3. Steam sterilisability has been demonstrated. Conclusion: The equipment complies with the criteria.	YES <input checked="" type="checkbox"/>
	NO <input type="checkbox"/>
4. Bacteria tightness has been demonstrated. Conclusion: The equipment complies with the criteria.	YES <input checked="" type="checkbox"/>
	NO <input type="checkbox"/>

Signature : 

Date : 09.08.2016

The original of this form will be kept together by the EHEDG or the EHEDG Authorized Organisation with the application, the inspection report, the evidence provided and any other relevant documentation, as listed on the back.

Type EL ASEPTIC Class I Certification:	Yes <input checked="" type="checkbox"/>
Cross out as appropriate.	

No.	Description
1.	EHEDG / TUM Certificate of Compliance
2.	Contract to use the EHEDG Certification Logo for equipment
3.	Appendix 1A: EHEDG authorized certification organisations
4.	Appendix 1B: equipment intended for cleaning with liquids
5.	Appendix 2: conditions for use of the EHEDG Certification Logo
6.	Appendix 3: Equipment evaluation form
7.	Evaluation report of the design of the retractable assembly Cleanfit type CPA875 with EPDM gaskets No. 494TUM2016
8.	Drawing of the retractable assembly Cleanfit type CPA875 with EPDM gaskets; drawing no. 402008-2415 original stamped
9.	Test report of the in-place cleanability test method, no. 462/28.04.2014
10.	Test report of the in-line steam sterilisability test method, no. 494/11.03.2015
11.	Test report of the bacteria tightness test method, no. 494.1/11.03.2015
12.	Example of the EHEDG Certified Logo Type EL ASEPTIC Class I